


## Location of LWCO on water boilers

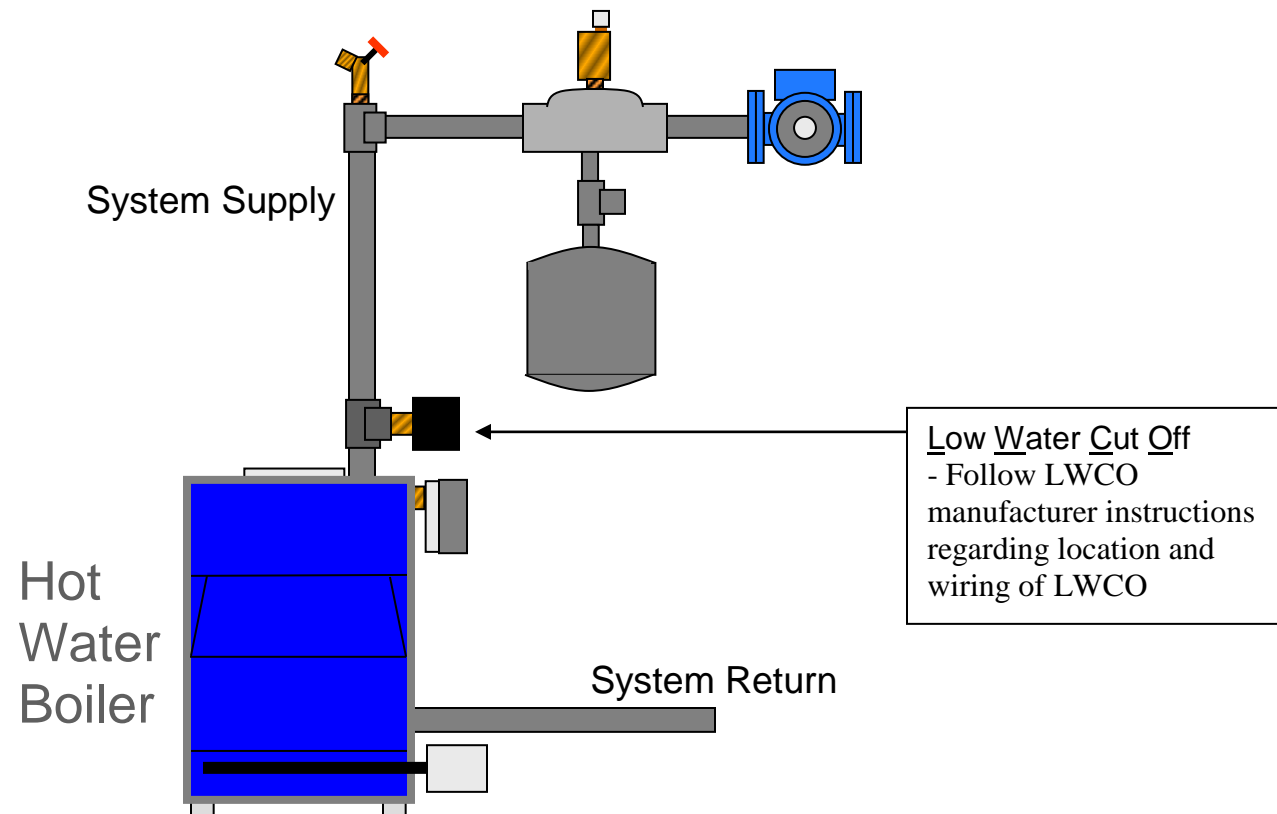

## Recommended Location for Secondary LWCO

**NOTE:** Refer to boilers Installation and Operating manual for details regarding Near Boiler Piping.

Locate Probe type secondary LWCO in the equalizer piping, at the same height as the top of the lowest sight glass tapping located on the front of the boiler

